

**NOTES:**

1. The most recent results for each sample location were used in the generation of this map.
2. This drawing is intended to be used as an overview of the general concentration conditions at the site.
3. Features denoted with an asterisk ( \* ) were placed based on figures from the 2002 IE Site Characterization Report or from field observations. Location is approximate.
4. MDEQ Part 201 Criteria dated December 30, 2013.

Figure **2**

Soil Drinking Water Protection Criteria (DWPC)  
Exceedances Map

Chlorinated VOCs  
Interval: 0 - 2.5 Feet Below Ground Surface


DIAMOND CHROME PLATING, INC  
HOWELL, MICHIGAN









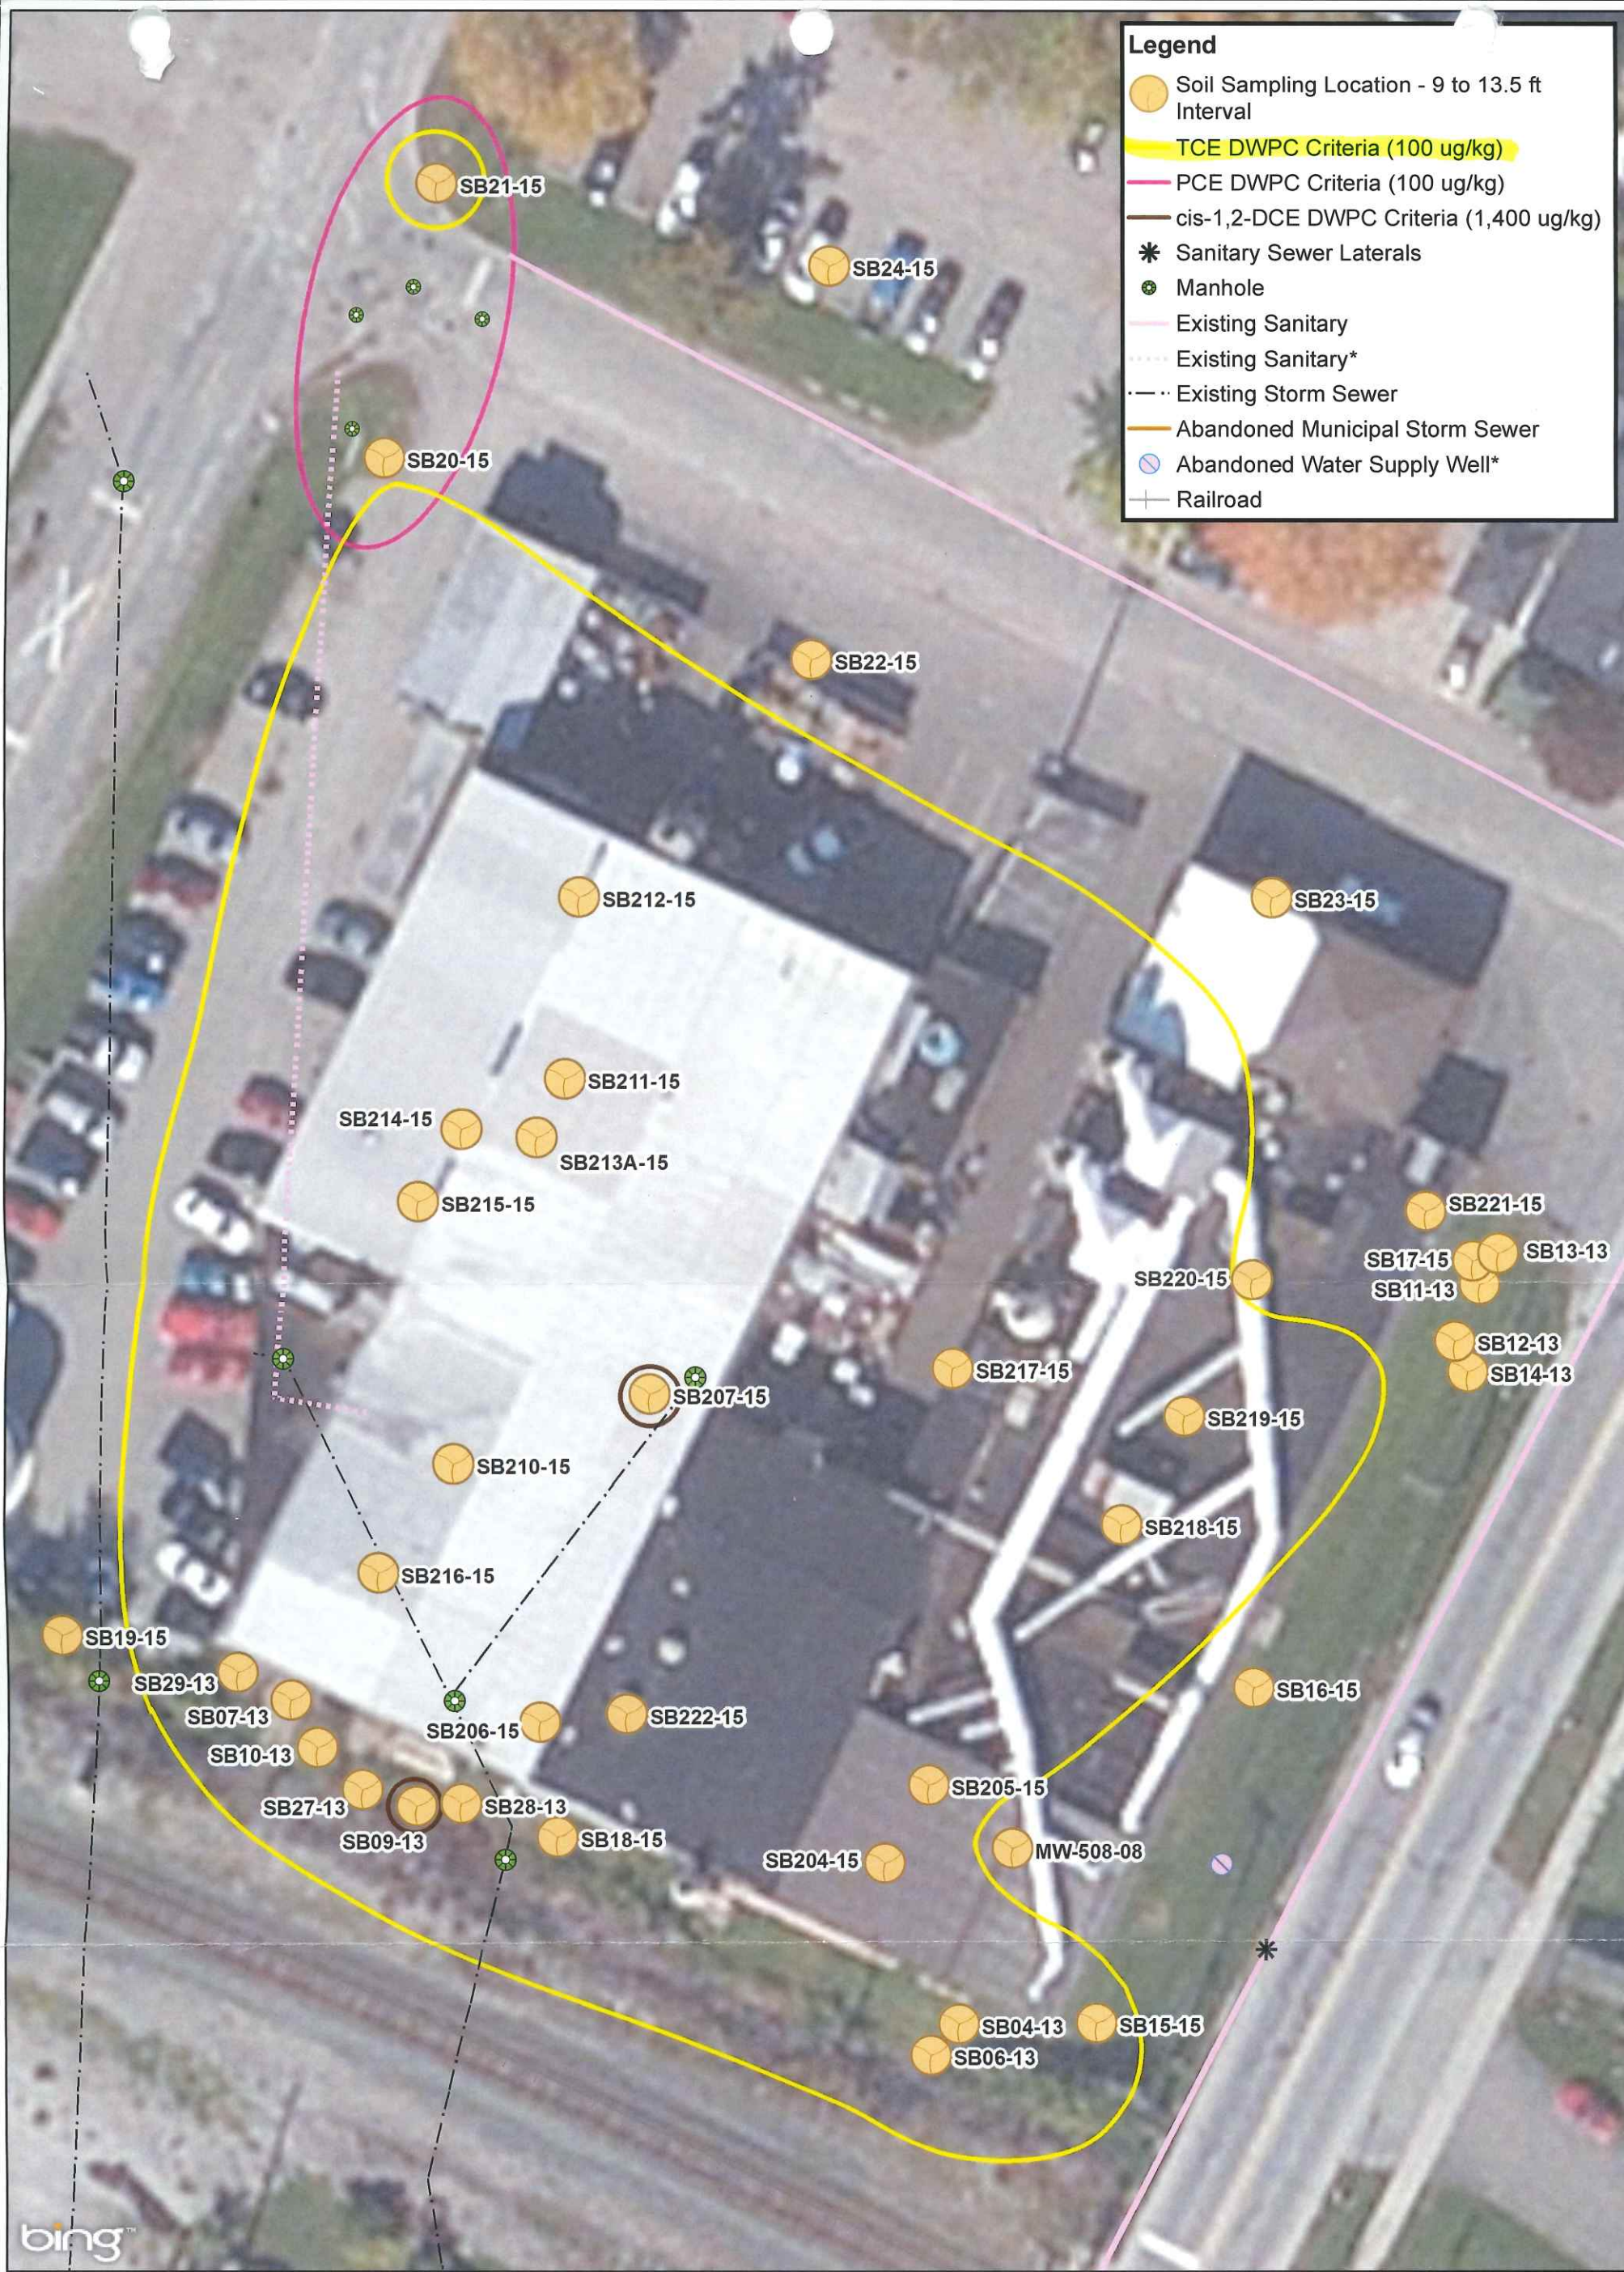

**NOTES:**

- The most recent results for each sample location were used in the generation of this map.
- This drawing is intended to be used as an overview of the general concentration conditions at the site.
- Features denoted with an asterisk (\*) were placed based on figures from the 2002 IE Site Characterization Report or from field observations. Location is approximate.
- MDEQ Part 201 Criteria dated December 30, 2013.

Figure 4  
Soil Drinking Water Protection Criteria (DWPC)  
Exceedances Map  
Chlorinated VOCs  
Interval: 9 - 13.5 Feet Below Ground Surface  
DIAMOND CHROME PLATING, INC  
HOWELL, MICHIGAN

